



This certification form must be completed by a "City Certified" Plumber or Grease Waste Hauler

GREASE INTERCEPTOR CERTIFICATION (Form A)
Clarksville Wastewater Department

Every food service establishment in the City of Clarksville, TN must have their grease interceptor certified annually, to verify that all components of the grease control equipment are present and in good working condition.

Facility Name: _____ Phone #: _____

Address: _____ City: _____, TN. Zip Code _____

- 1. Interceptor completely emptied and cleaned before inspection?
2. There is access to all interceptor chambers for cleaning and inspections?
3. Influent (inlet) T is attached and extends downward at least 2/3 depth of tank?
4. Effluent (outlet) T is attached and extends downward to within 12" of tank bottom?
5. Effluent (outlet) T is made of non-collapsible material that does not easily flex or bend...
6. Interceptor tank does Not have visible holes or leaks?
7. Mid-wall baffle(s) is secure and operational?
8. Interceptor maintaining structural integrity?
9. No Sewer clean-out covers missing or damaged?

* IMPORTANT REQUIRED INFORMATION & RESPONSE: If the answer to any of the above questions is "Fail", the equipment has failed certification. A statement of the plan of action to be taken, with date to be completed, needs to be provided on the attached sheet under "Response Comments" (attach additional sheets to explain corrective action if necessary):

Inspector Certification - This grease interceptor has [] PASSED [] FAILED certification.

I _____ of _____
(print name of inspector) (print company name)
certify that the above listed facility has an approximate _____ gallon capacity interceptor. I have examined the interceptor and provided the above information.

_____, (signature) _____, (date) _____, (phone number)

Facility Owner/Manager Certification

I _____ certify to the best of my knowledge the above
(print name)
statements to be true and correct.


_____, (signature) _____, (date)

SUBMIT ORIGINAL CERTIFICATION FORM TO:

Clarksville WW Dept., Attn: FOG Control Program, 2215 Madison Street, Clarksville, TN 37043

MUST COMPLETE ALL INFORMATION

Grease Interceptor Diagram

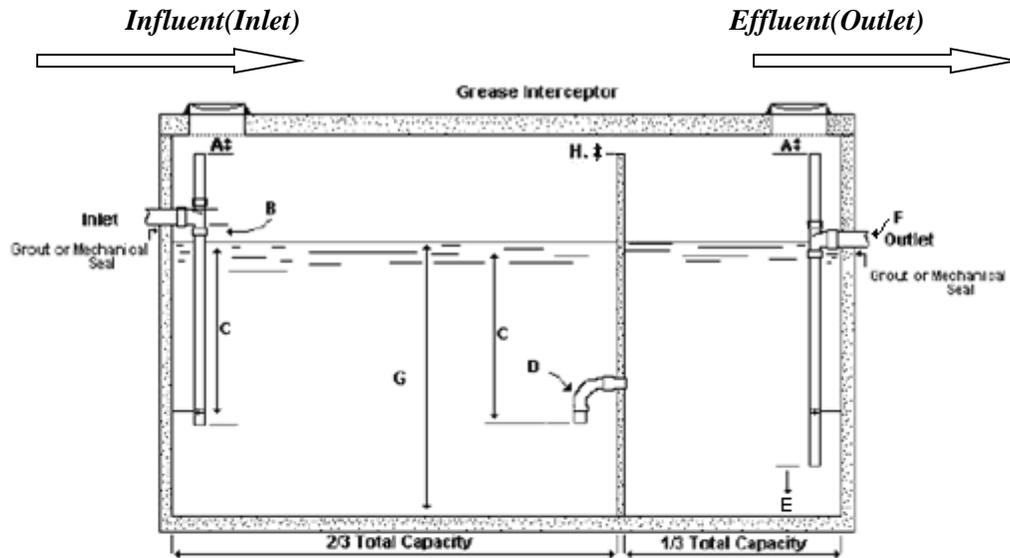

- A.) Minimum 6" , but not less than pipe diameter.
- B.) Inlet pipe invert to be 2 1/2" above liquid surface.
- C.) Inlet pipe to terminate 2/3 depth of water level.
- D.) 90 degree Sweep, minimum size - 6" and same depth as inlet pipe
- E.) 12" from floor to end of outlet pipe.
- F.) Outlet pipe no smaller than inlet pipe, minimum - 4".
- G.) Minimum depth of liquid capacity - 42".
- H.) Maximum distance from ceiling - 6".

RESPONSE COMMENTS (required if "Fail" checked, identify problem, corrective action and provide planned date of corrective action)
